



位置図



位置図(拡大)

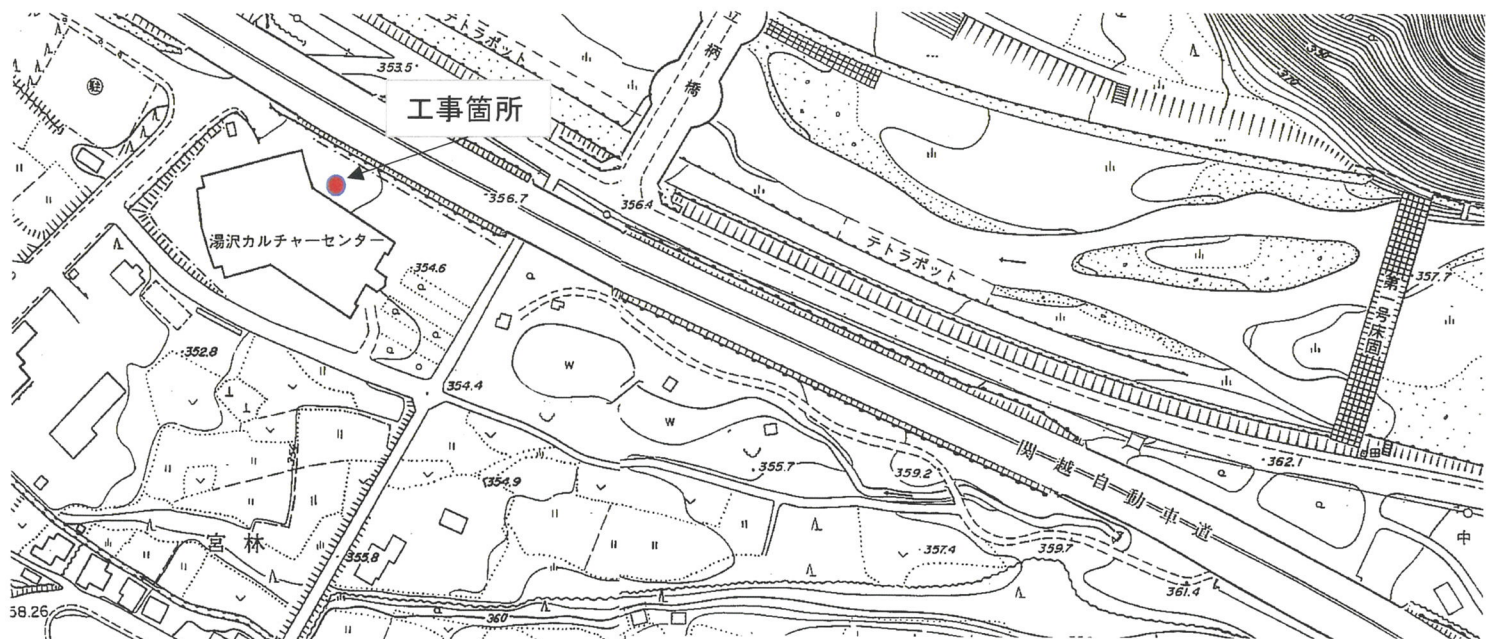

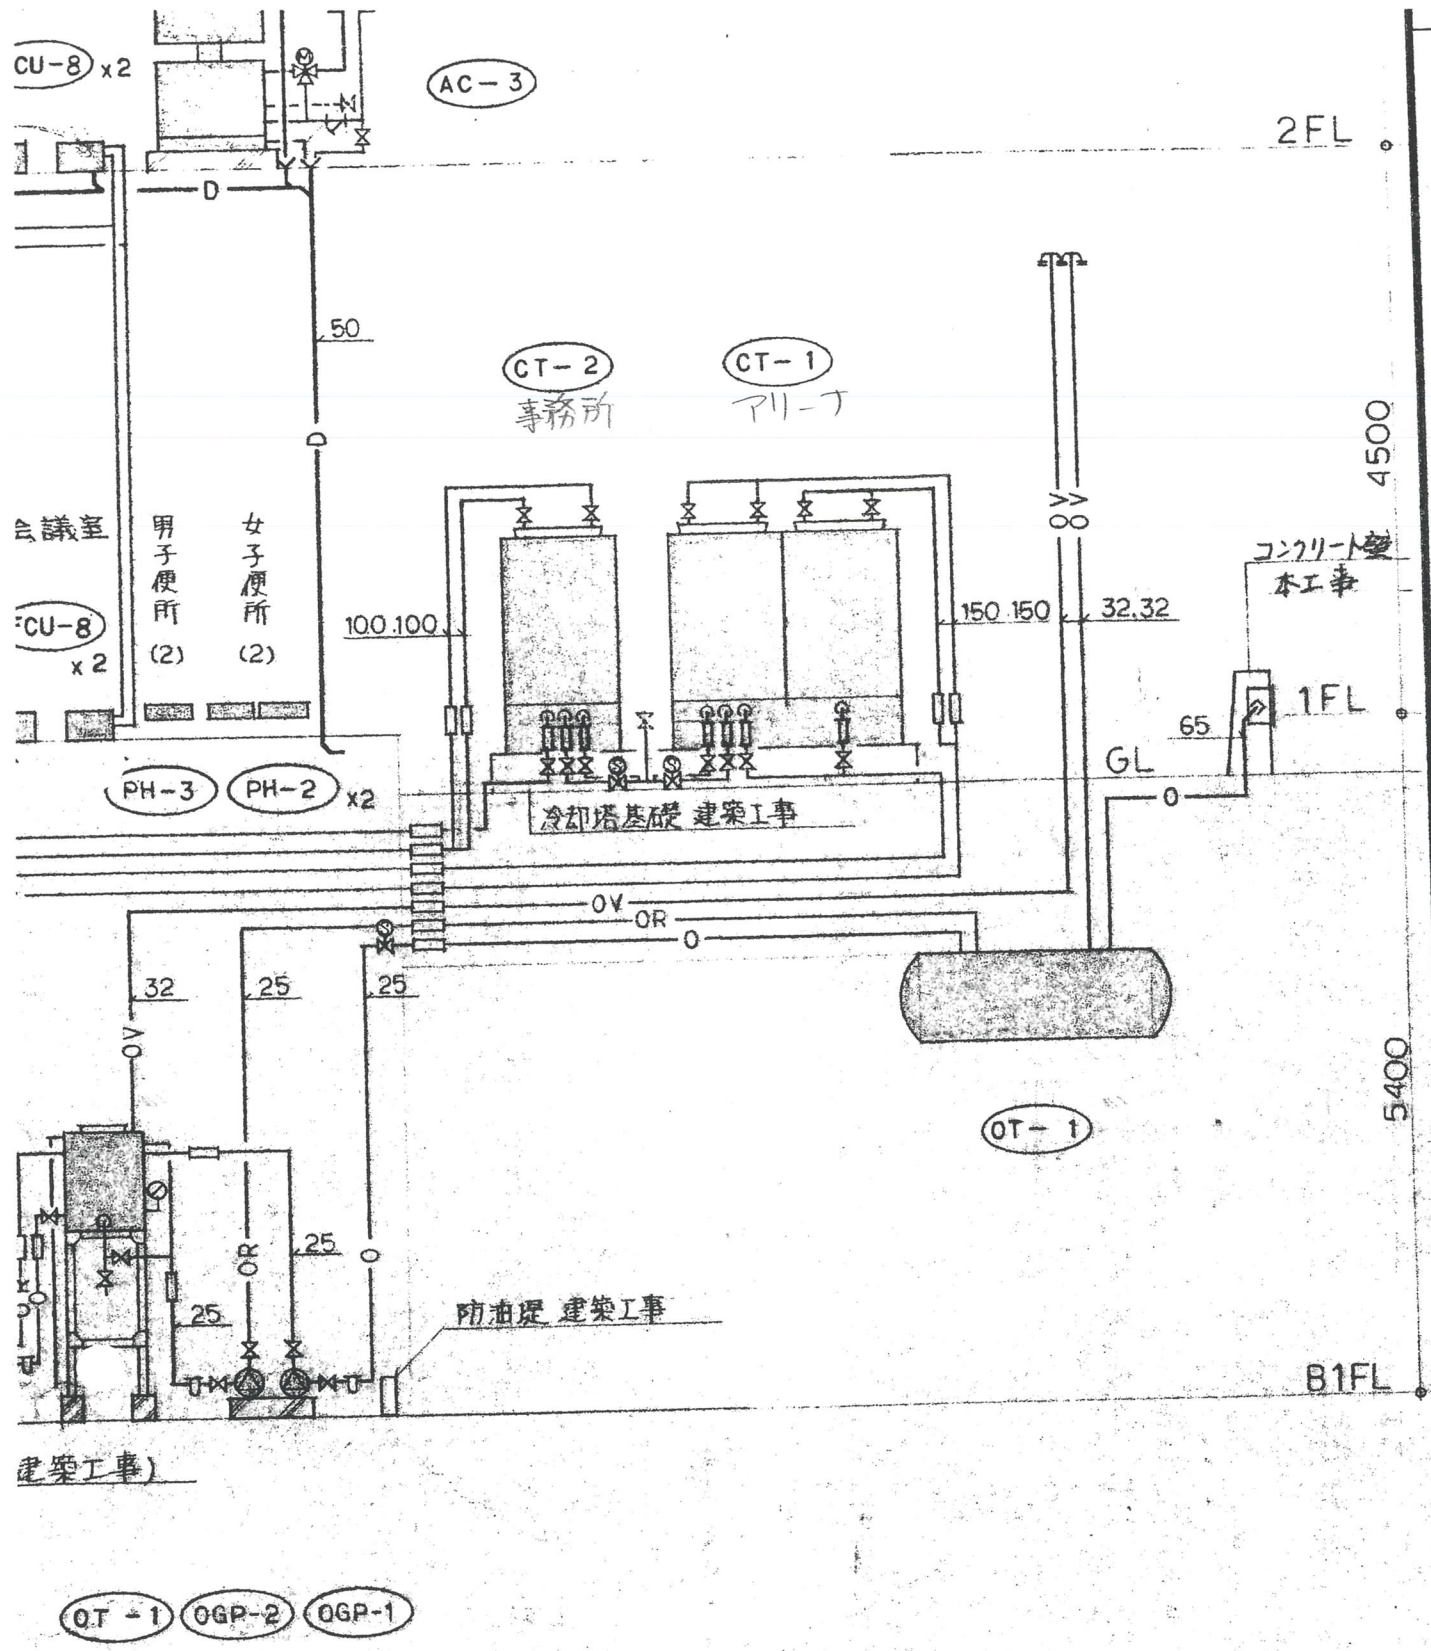

	CT-1	CT-2
冷却水入口	100GV x 4	100GV x 2
冷却水出口	125GV x 2	125GV x 1
"	FJ 125 x 2	FJ 125 x 1
補給水(予)	32GV	25GV
"	FJ 32	FJ 25
補給水(自)	32GV	25GV
"	FJ 32	FJ 25
"	電磁弁裝置 32	電磁弁裝置 25

